

INSTALLATION MANUAL FOR RECTANGULAR DUCTS

PAROC® PRO SLAB (WR) 640/660 CLAD

MINIMUM
INSTALLATION
TEMPERATURE:
10 °C



PAROC®

CONTENTS

| | |
|--|----|
| Preparation of ducts and insulation work | 3 |
| Tools and Templates | 3 |
| Rectangular straight ducts | 4 |
| Insulation of elbows and figures parts | 13 |
| Contact us | 17 |

Quick access: Click on the desired product or content page to immediately navigate to it. Clicking on 'Table of Contents' will direct you back to the index page. Hyperlinks will take you to relevant additional pages or research sources.



PREPARATION OF DUCTS AND INSULATION WORK

- The ducts must be in a clean and tightly installed condition.
- Protect the clad materials and installations from moisture.
- The recommended processing temperature is $\geq 10\text{ }^{\circ}\text{C}$ and $\leq 40\text{ }^{\circ}\text{C}$.
- All areas to be insulated are easily accessible - the required insulation thickness can be maintained.
- The insulation thickness should be dimensioned so that the supports and duct flanges can be integrated into the insulation system.
- The working time may be longer if reductions, changes in shape (circular to rectangular) or branches as well as numerous attachments have to be insulated.

TOOLS AND TEMPLATES



- A marker



- Folding rule



- **PAROC® Clad Alu Tape**



- **PAROC® Pro Knives**



- Welding Pins (insulated)



- Welding Device



- **PAROC® Clad Alu Dots**



- Spray adhesive



- 90 degree profile



- Circle





- Cutter knife

RECTANGULAR STRAIGHT DUCTS


To prevent stagnant water from reaching the roof of the ducts, a slope must be installed.



PAROC® Pro Duct Wedges give the duct the correct gradient of approximately 3% and are tailored to the duct surface.

First, measure the height and width of the duct. Then, depending on the size of the duct, PAROC® Pro Duct Wedges should be cut to size (see recommendations). Finally, they are fixed to the duct with the help of spray adhesive and welding pins.

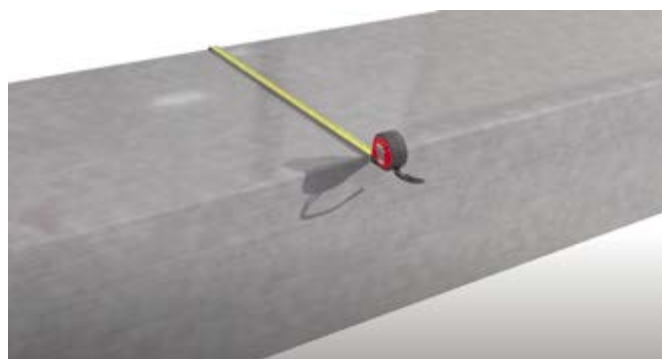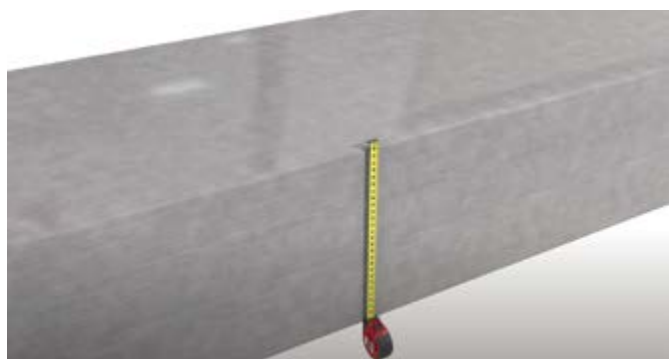

STEP 1: Installation of wedge

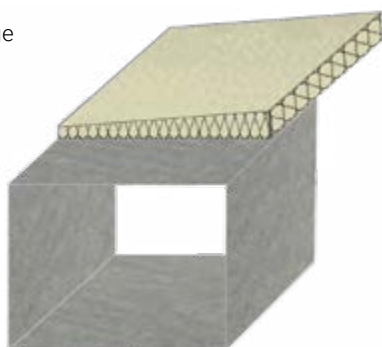
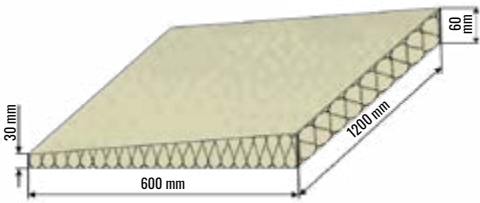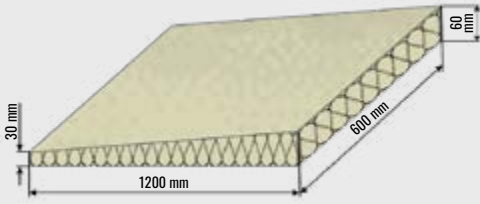
| Recommendations | | |
|--------------------|-----------------------------|--|
| Air duct with [mm] | Dimension of the wedge [mm] | |
| <600 | 30/60×600×1200 |  |
| 600-1200 | 30/60×1200×600 |  |



DEPENDING ON THE SIZE OF THE DUCT, THE CORNERS CAN BE DESIGNED IN 2 OPTIONS:

OPTION 1

Cutting out straight strips of stone wool

Cut the slab up to the coating (distance between cuts = insulation thickness). Please ensure that the clad coating is not damaged. Remove the cut-outs from the slab and dispose of them properly. Repeat this process for each edge.

When cutting the slabs to size, please ensure the joints are below the duct. As a result, the slab can be closed smoothly or sealed with PAROC® Clad Alu tape.

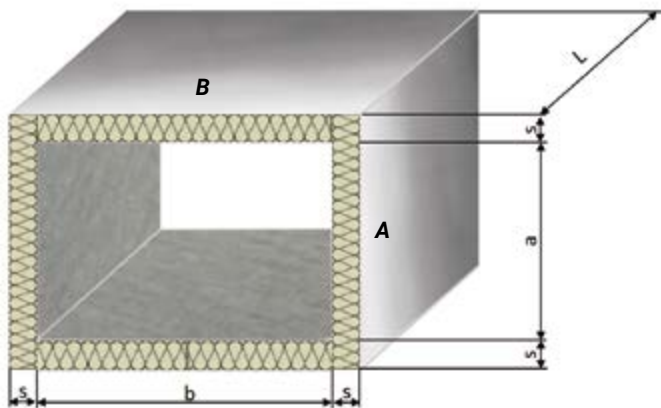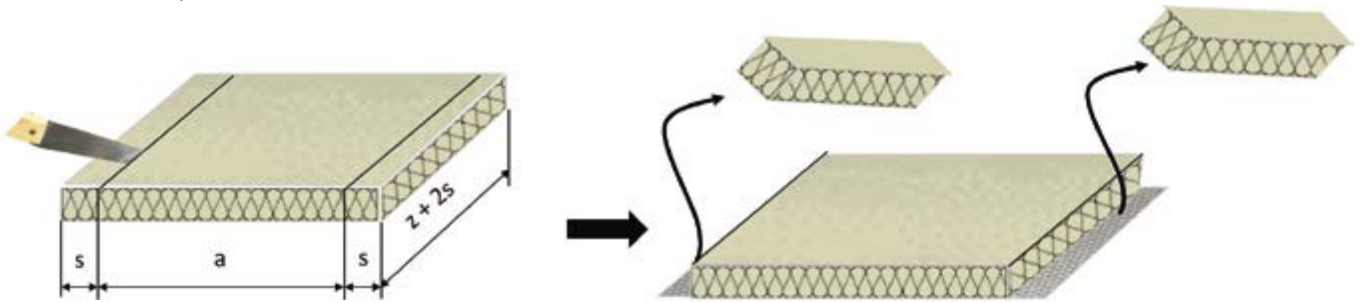


Use this formular to calculate the needed material:

$$A_{width} = (a + 2 \cdot s)$$




$$B_{width} = (b + 2 \cdot s)$$

a – duct height
b – duct width
s – insulation thickness
L – duct length

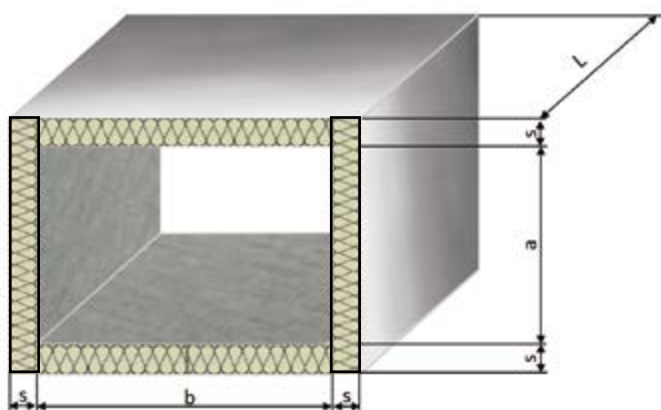

The two sides of the duct (*a*) are cut to size including the insulation thickness ($2xs$).

A commercially available spray adhesive can be used to fix the sides and bottom part.

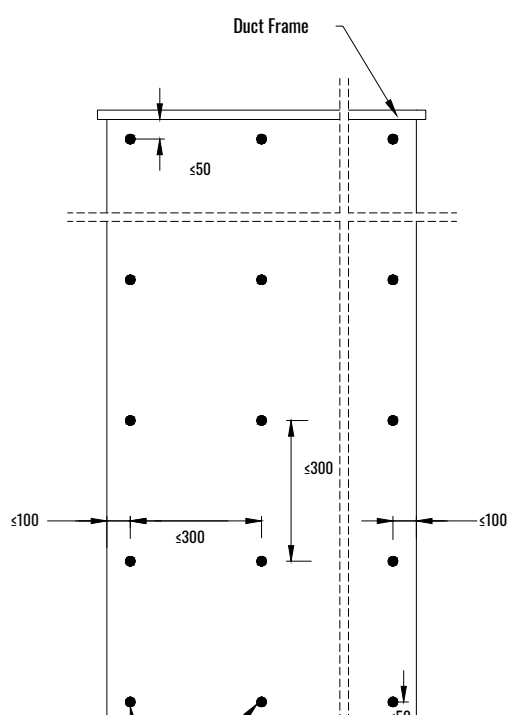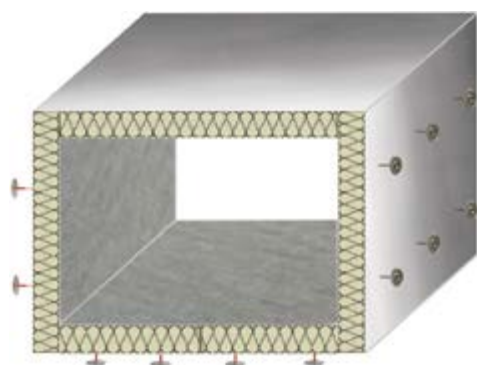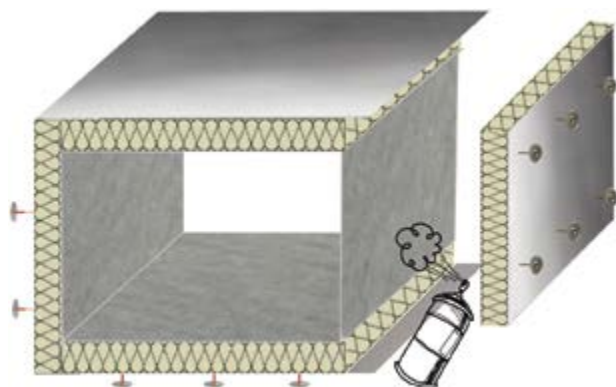

Mount the PAROC® Pro Slab (WR) 640 or 660 Clad on the sides and the rear of the duct. To facilitate the installation, spray adhesive can be used. For permanent mechanical fixing fastening to the duct, we recommend the use of welding pins with a maximum distance of 300 mm. To ensure an even positioning of the welding pins, we recommend the use of an appropriate template.

Recommendation (according to DIN 4140)
Number of welding pins;

Above - no pins required
Sides - approximately 6 pcs/m²
Below - approximately 9 pcs/m²

PAROC® Pro Slab (WR) 640 or 660 Clad has an overlap of approximately 5-10 mm so that the joints can be covered and sealed tightly. It is recommended to align the overlaps along the direction of flow.



All longitudinal and butt joints are glued or sealed with PAROC® Clad Alu Tape. A plastic spatula is recommended for evenly pressing the PAROC® Clad Alu Tape onto the slabs to ensure a permanently tight bond.



To seal the welding pins, use the PAROC® Clad Alu Dots. To increase the tightness of the PAROC® Clad Alu Dots, a plastic spatula is also recommended as a support. A cardboard template can be produced to optimise the appearance of the welding pins.



Always make sure that tape is applied without wrinkles and openings. Use a spatula to smoothen out any air bubbles. There must be no gaps or "pockets" where water can accumulate.





Tape position: Avoid joining the tapes in the top half of the duct (between 9 o'clock and 3 o'clock when looking at the clock face). This area is more exposed to environmental factors such as rain, wind, and sunlight, which can affect the integrity of the tape over time. By avoiding tape joints in this upper section, you reduce the risk of water infiltration and other damage. Instead, placing the joints in the lower half (between 3 o'clock and 9 o'clock) ensures they are less exposed and better protected, leading to a more durable and reliable seal.

INSULATION OF THE DUCT WITH V-CUTS


OPTION 2 (recommended)

Cutting out V-cuts from PAROC® Pro Slab (WR) 640 or 660 Clad


This procedure is recommended to adhesions with the PAROC® Clad Alu Tape.

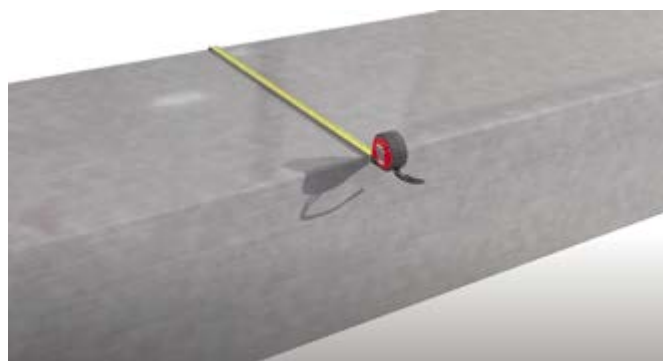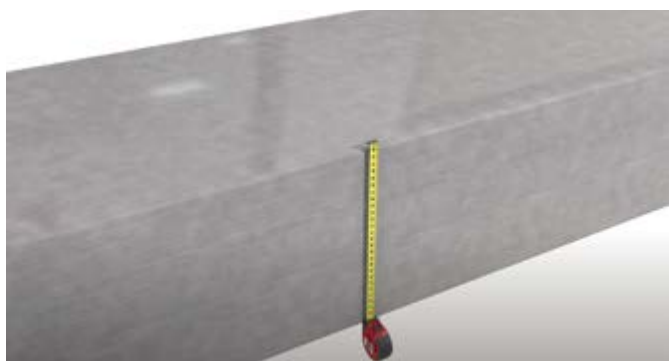


First the width and height of the duct are measured. Then depending on the size of the duct, the slab must be divided into sections, and the joints should be on the sides. Joints of the duct should be avoided.

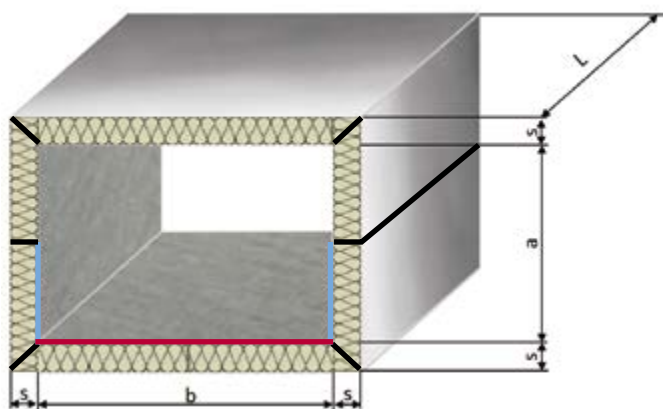

(a) the height of the duct is marked on the slab. The V-cut results from $2 \times 45^\circ$; these can be made with a profile (sheet metal). Then the width (b) of the duct is marked. Depending on the size of the duct, the slab must be cut in half at the sides.

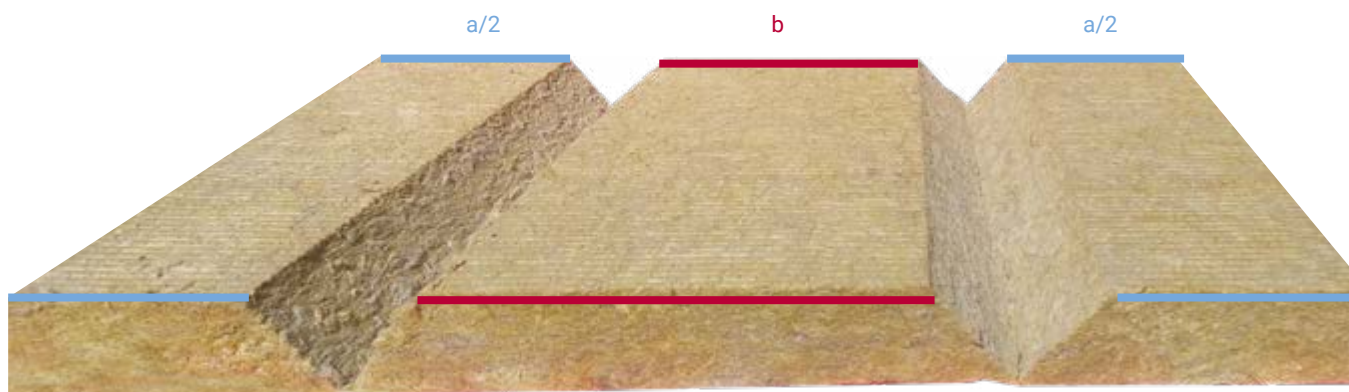


The V-cuts can be produced using a self-made template (90° profile)

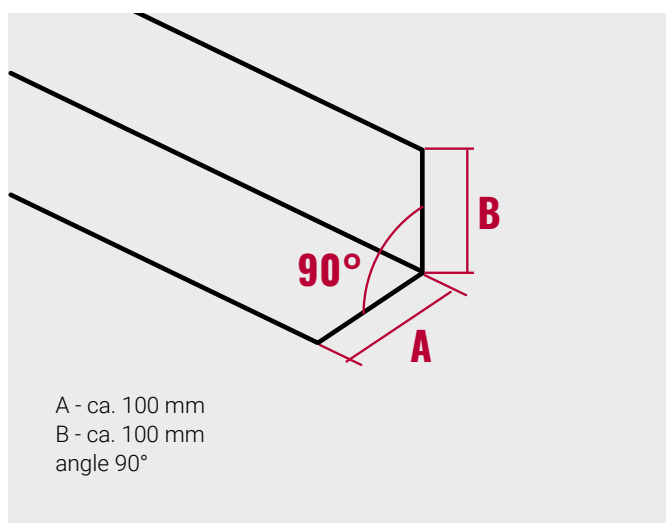

We recommend fixing to the duct and PAROC® Pro Slab (WR) 640 and 660 Clad with in the V-cuts using spray adhesive to ensure there are no gaps.

The V-cuts can be produced using a self-made template (90° profile)

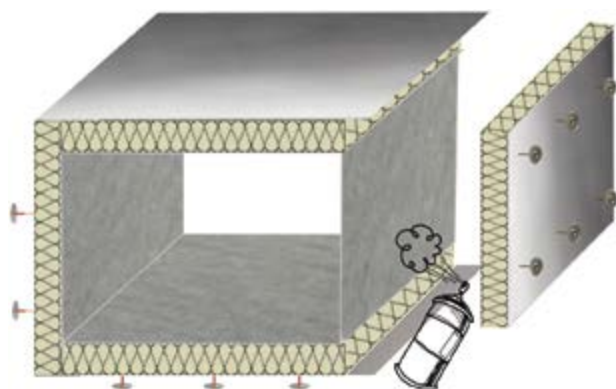

After the second half has been produced, the slabs and V-cuts are fixed with spray adhesive and secured with welding pins (Option 1), then all joints are taped with PAROC® Clad Alu Tape.



Duct flanges or suspensions are integrated into the insulation. Cut the incisions as accurately as possible so that the air gaps are not too large.



Tape position: Avoid joining the tapes in the top half of the duct (between 9 o'clock and 3 o'clock when looking at the clock face). This area is more exposed to environmental factors such as rain, wind, and sunlight, which can affect the integrity of the tape over time. By avoiding tape joints in this upper section, you reduce the risk of water infiltration and other damage. Instead, placing the joints in the lower half (between 3 o'clock and 9 o'clock) ensures they are less exposed and better protected, leading to a more durable and reliable seal.

Always make sure that tape is applied without wrinkles and openings. Use a spatula to smoothen out any air bubbles. There must be no gaps or "pockets" where water can accumulate.




INSULATION OF ELBOWS AND FIGURES PARTS

There are two options for insulating the duct-elbow:

Option 1 - the long side (z) of the duct-elbow using PAROC® Pro Lamella Mat Clad

Option 2 - complete with PAROC® Pro Slab (WR) 640 or 660 Clad

OPTION 1


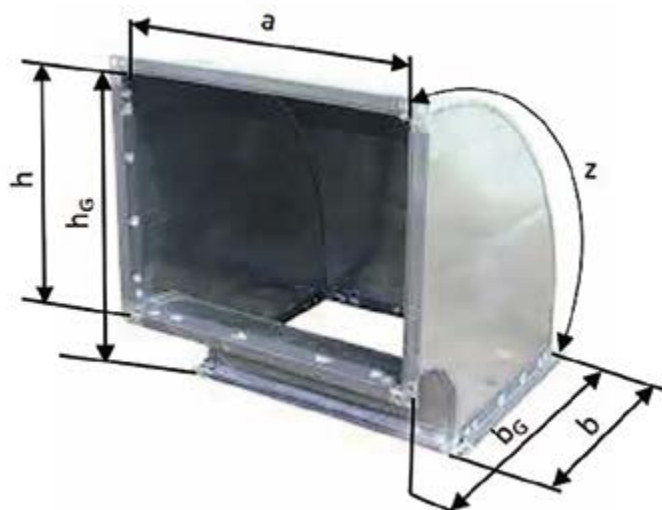


1. measure length

- h – duct height
- h_g – total height of duct
- a – duct width 1
- b – duct width 2
- b_g – total width of duct
- z – length of duct back
- s – insulation thickness

Cut the duct sides according to the formula below and mark the radius of the duct bend. For small bends we recommend using a drawing circle. For larger ones, the radius can be marked using a folding ruler. **Be sure to add the insulation thickness to the duct dimensions!**


$$\text{Cutting}_{\text{duct sides}} = (b_g + s) \cdot (h_g + s)$$

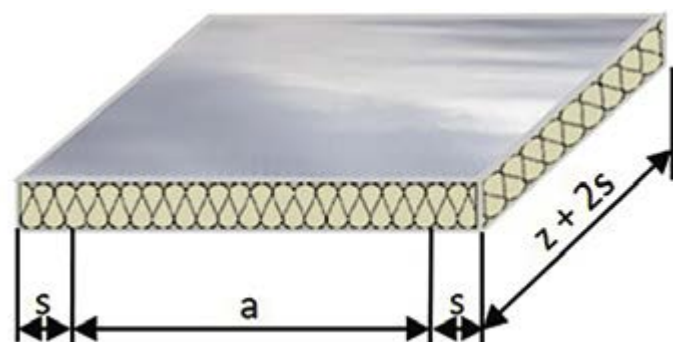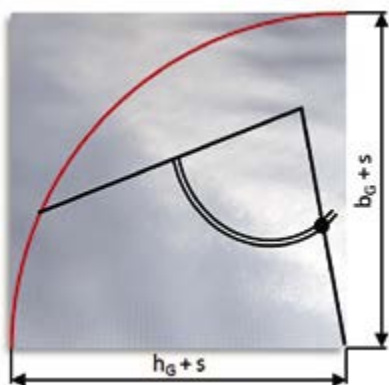

Now cut the back of the canal according to the following formula:



$$\text{Cutting}_{\text{duct bend}} = (a + 2 \cdot s) \cdot (z + 2 \cdot s)$$

The lamella mats are then cut on the side up to the coating (s = insulation thickness). Remove the two-sided cut-outs and then use the remaining clad lamination as a "cover" for those surfaces on the side..

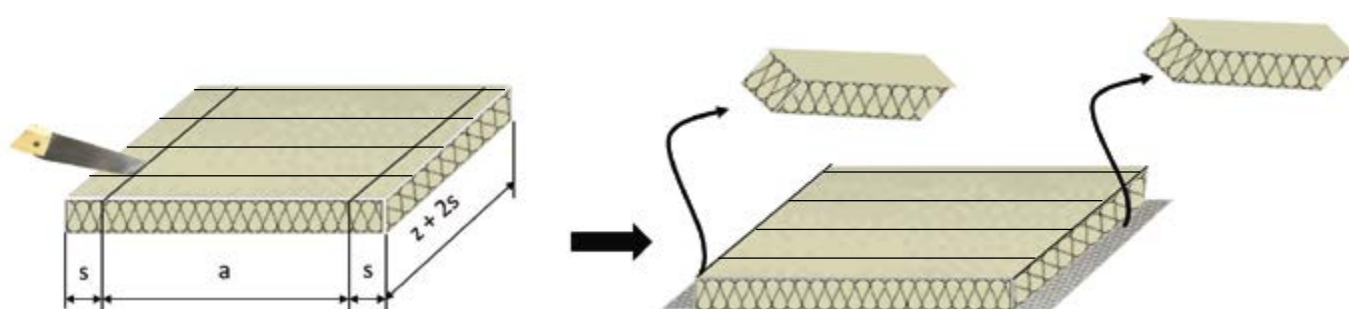


Mount the PAROC® Pro Lamella Mat Clad on the duct sides and back. In order to make the installation easier, a spray adhesive could be used. For the permanent mechanical fixation on the duct we recommend using welding pins; with a maximum distance of 300 mm. To ensure a uniform positioning of welding pins, we recommend using a corresponding template.

The joints of the arched connections must be sealed with PAROC® Clad Alu Tape.

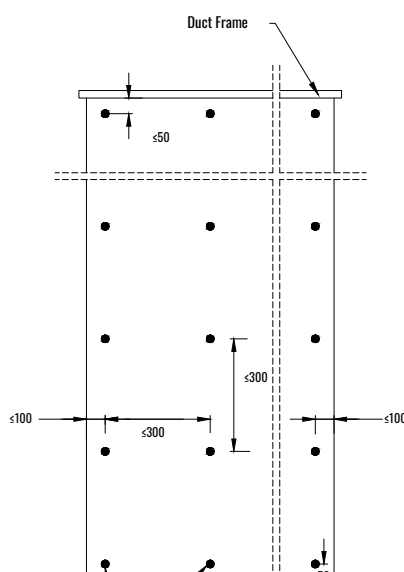

OPTION 2

Insulation of duct elbow / complete with PAROC® Pro Slab (WR) 640 or 660 Clad

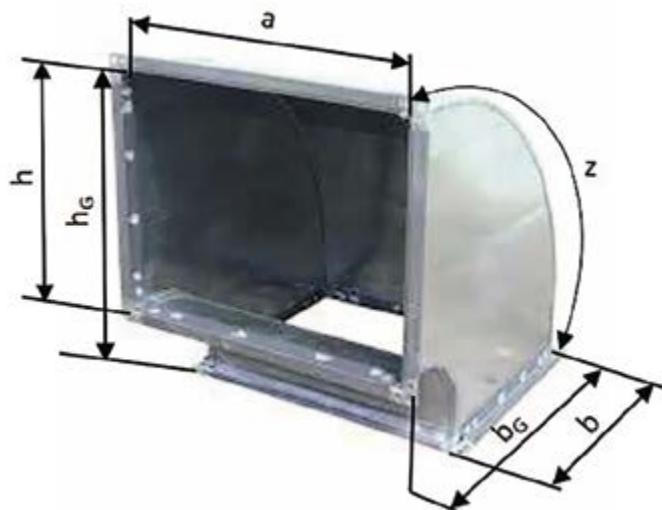

1. measure length

- h – duct height
- h_g – total height of duct
- a – duct width 1
- b – duct width 2
- b_g – total width of duct
- z – length of duct back
- s – insulation thickness

The side parts are produced as in option 1 - for smaller insulation thicknesses 20-30 mm, the assembly can be installed as shown in Option 1.

The following formula is recommended;

PAROC® Pro Slab (WR) 640 or 660 Clad

side parts: $b_g \times h_g$

bends (radius) are cut flush along the bend

PAROC® Pro Slab (WR) 640 or 660 Clad

long side: $(a+2xs) \times (z+2xs)$

To make the slab flexible, small V-cuts are cut every 100 mm.



After fitting and fixing to the duct, the mechanical fixing is carried out using the welding pins as in option 1. All joints and connections are taped using PAROC® Clad Alu Tape.





PAROC SALES OFFICES AND CONTACTS

Headquarter / Finland

Paroc Group Oy / Paroc Oy Ab
P.O. Box 240
FI-00181 Helsinki, Finland
Energiakuja 3
Phone: +358 46 876 8000
Email: [Contact us in Finland](#)



Belgium / The Netherlands / France

Email: [Contact us in Belgium French](#)
Email: [Contact us in Belgium Dutch](#)
Email: [Contact us in Netherlands](#)
Email: [Contact us in France](#)



Denmark

Paroc Danmark Filial af PAROC AB
Helsingør Erhvervspark A/S
H P Christensensvej 1
DK-3000 Helsingør
Tel. +45 49 12 10 00
Email: [Contact us in Denmark](#)



Estonia

AS Paroc
Pärnu mnt 158
EE-11317 Tallinn, Estonia
Tel. +372 651 8100
Email: [Contact us in Estonia](#)



Germany / Switzerland / Austria

Paroc GmbH
Heidenkampsweg 51
D-20097 Hamburg, Germany
Tel. +49 40 33 49 60000
Email: [Contact us in DACH area](#)



Latvia

SIA Paroc
Vienības gatve 109
Rīga, LV-1058, Latvia
Tel. +371 7 339053
Email: [Contact us in Latvia](#)



INTERNATIONAL CONTACTS

Business Director Industry

Peter van Zandbergen

peter.van.zandbergen@owenscorning.com

Segment Manager Industry

Fredrik Saterborn

fredrik.saterborn@owenscorning.com

Technical Support

Craig Treanor

craig.treanor@owenscorning.com

Lithuania

UAB Paroc
Savanoriu 124
03153 Vilnius, Lithuania
Tel. +370 5 2740 000
Email: [Contact us in Lithuania](#)



Norway

Paroc AB Norge
Rosenholmveien 25
NO-1414 Trollåsen, Norway
Tel. +47 22 64 59 00 / 01
Email: [Contact us in Norway](#)



Poland

Paroc Polska sp. z o.o.
ul. Gnieźnieńska 4
62-240 Trzemeszno, Poland
Tel. +48 61 468 21 90
Email: [Contact us in Poland](#)



Sweden

Paroc AB
SE-541 86 Skövde, Sweden
Visiting address: Bruksgatan 2
Tel. +46 500 469 000
Email: [Contact us in Sweden](#)



The United Kingdom / Ireland

Owens Corning Insulation (UK) Ltd
31-35 Kirkby Street
London EC1N 8TE
The United Kingdom
Email: [Contact us in UK & Ireland](#)



Disclaimer

The information relating to the products and systems contained in this communication ("Information") is accurate and reliable to the best of our knowledge as of its date issued and is subject to change without prior notice. No guarantee of accuracy is given or implied.

Since Paroc has no control over installation workmanship, accessory materials or conditions of application, no express or implied warranty of any kind, including those of merchantability or fitness for a particular purpose or course of performance or usage of trade, is made as to the performance of an installation containing Paroc products.

While the Information in this communication may relate to the technical application of certain Paroc products, it is in no event to be considered as technical advice on the basis of which Paroc may incur any liability.

User is solely responsible for determining whether a Paroc product is fit for a particular purpose and suitable for user's method of use or application.

Users of the provided Information assume full responsibility for all concept/design decisions made relating to the suitability of use.

Users must rely on their own judgment or that of a concept/design professional when determining how to best apply the data provided.

Users agree that Paroc is under no obligation to provide additional details, testing or test data on its behalf.

Liability of Paroc, if any, is strictly limited to replacement of product. In no event shall Paroc be liable for any other damages arising because of product failure, whether incidental, special, consequential or punitive, regardless of the theory of liability upon which any such damages are claimed.

Applications: March 2025

1251TIEN0325

© Paroc 2025

